

- A
- 3 CYY-F 5x4 mmp
  - 2 CYY-F 5x6 mmp
  - 1
  - 5 CYY-F 5x6 mmp
  - 4 CYY-F 5x4 mmp




Instalatie electrica incalzire in pardoseala



Circuit electric de comanda



Coloana electrica alimentare TEI



Cablu incalzitor Deviflex 18 T (18w/m)



Termostat tip Devireg







Tablou electric incalzire in pardoseala



Tablou electric general

### DETALIU PARDOSEALA INCALZITA

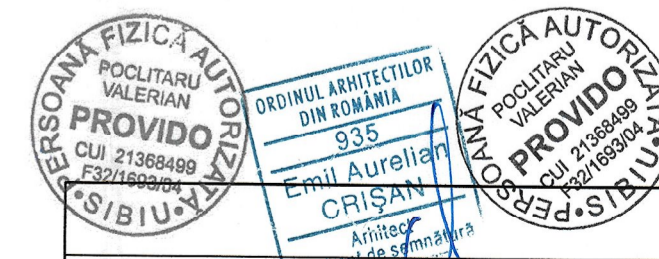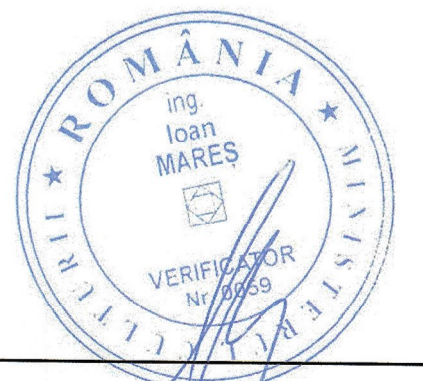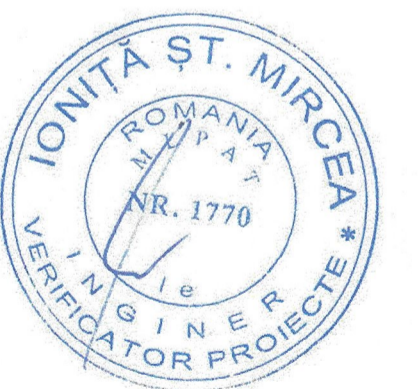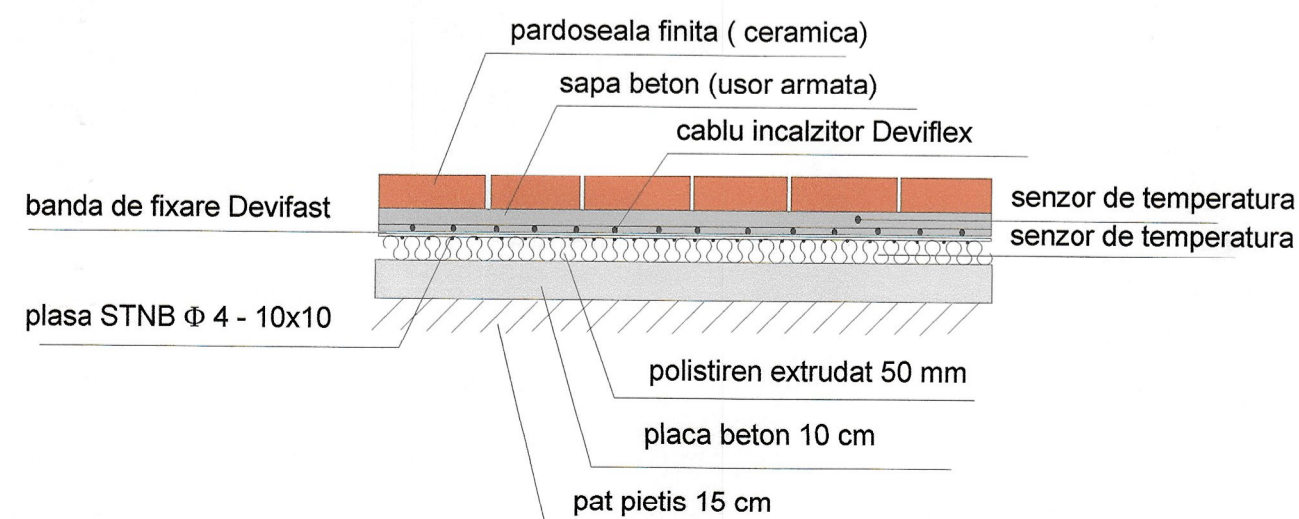

|   |                  |  |                    |
|---|------------------|--|--------------------|
| VERIFICATOR   | SEMNATURA        | CERINTA  | REFERAT NR/DATA    |
| <b>PROVIDO P.F.A.</b><br>F32/1693/2004<br>SIBIU, Bd. Victoriei, nr. 35<br>Tel/Fax 0269/214286, Tel 0766/416498        |                  | Beneficiar:<br>PAROHIA EVANGHELICA C.A. AGNITA | Proiect<br>18/2016 |
| SPECIFICATIE  | NUME             | SEMNAT   | SCARA              |
| Sef proiect   | arh E.A. Crisan  |  | Sc. 1:100          |
| Proiectat   | ing V. Poclitaru |  |                    |
| Proiectat   | ing V. Poclitaru | Data<br>05/2018                                |                    |
| Titlu proiect:<br>REABILITAREA ANSAMBLULUI BISERICII<br>EVANGHELICE FORTIFICATE<br>AGNITA - PIATA G.D. TEUTSCH NR 1-3 |                  | Faza<br>P.Th                                   |                    |
| Titlu plansa:<br>Instalatie electrica incalzire in pardoseala   |                  | Plansa<br>Nr. E0.16                            |                    |