






PLAN COTA +24.90m

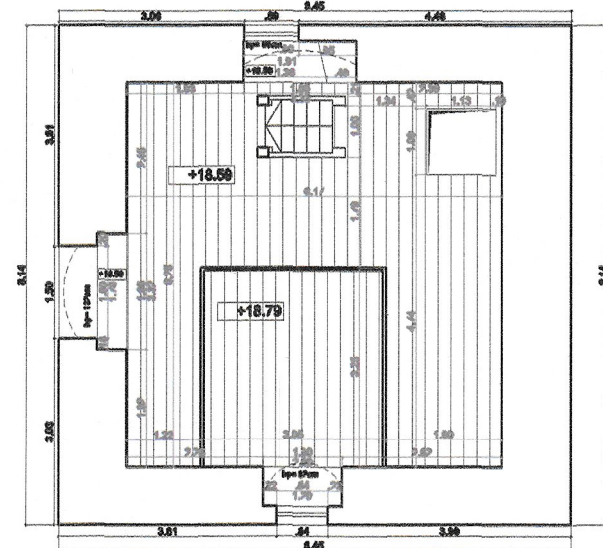

PLAN COTA +20.50m

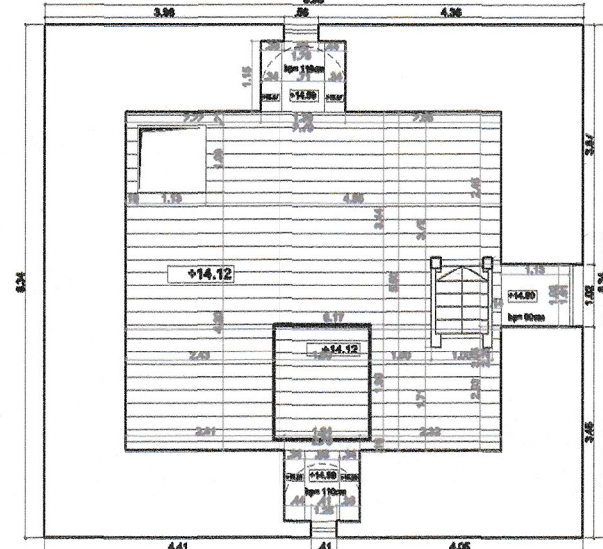


PLAN COTA +15.80m

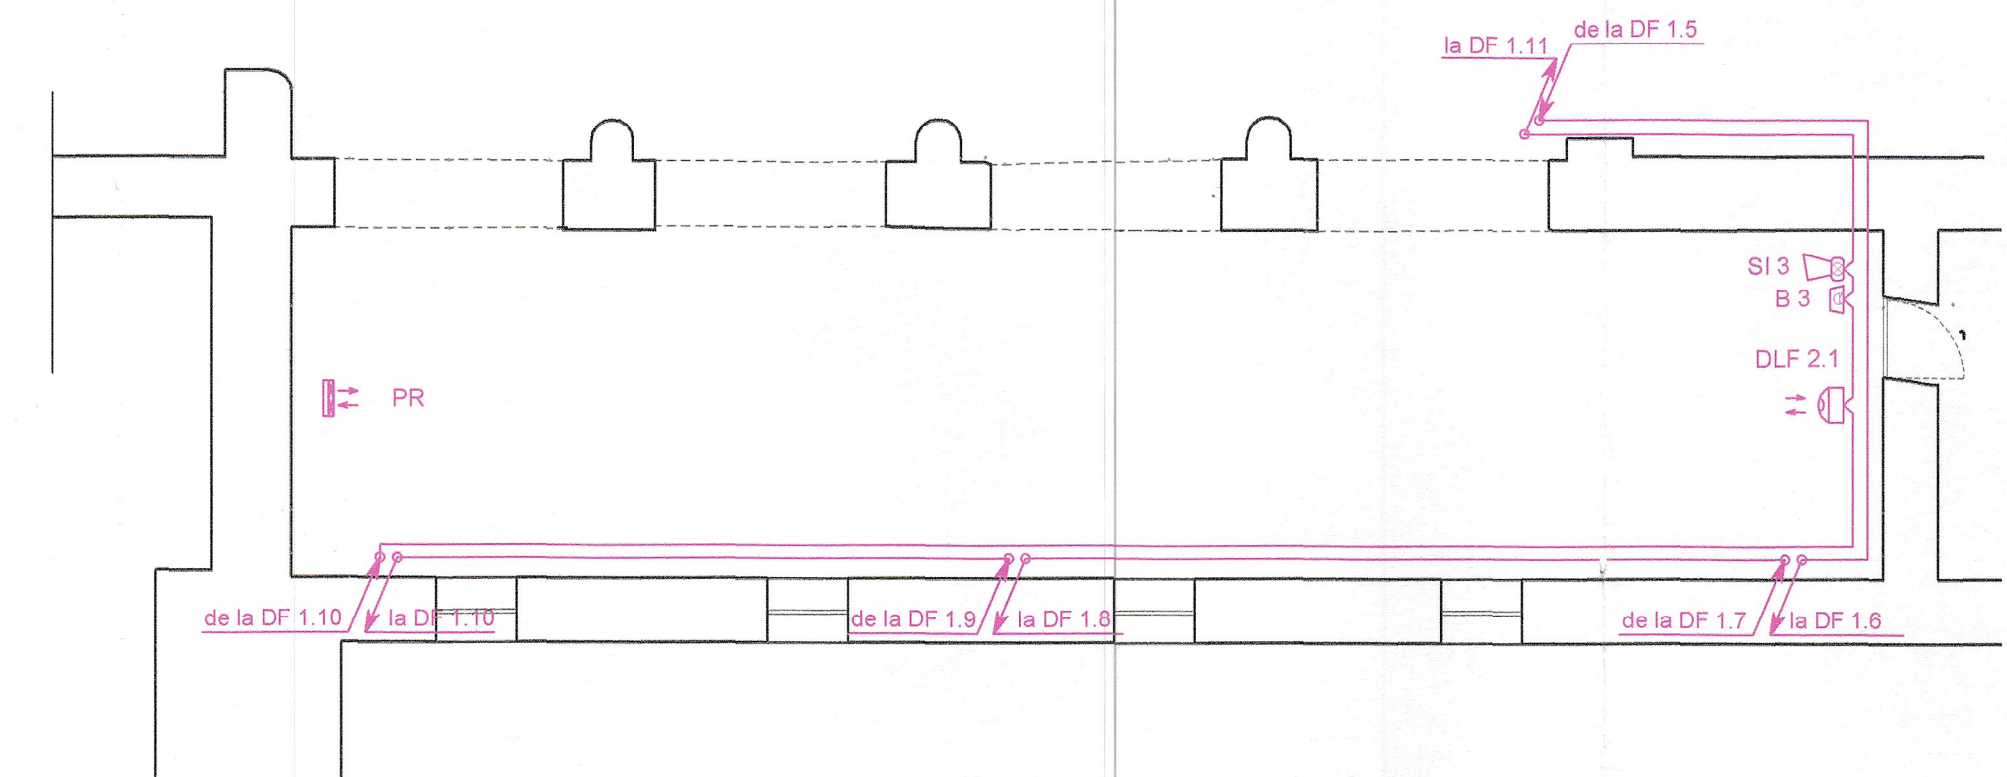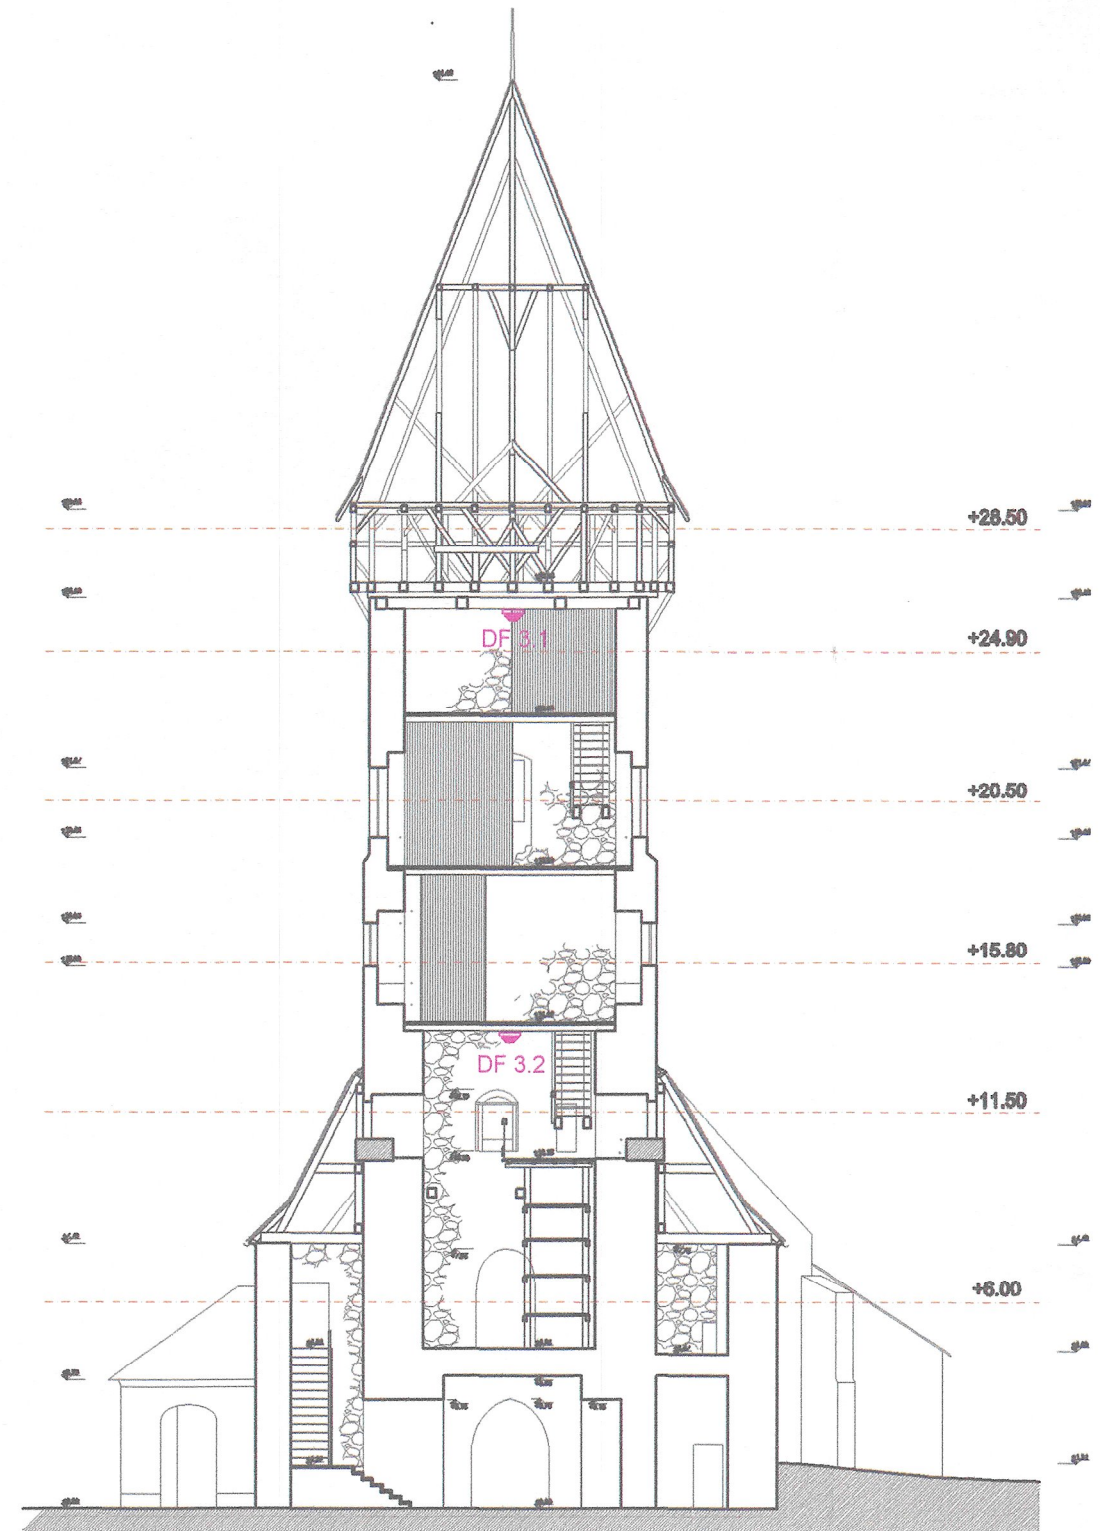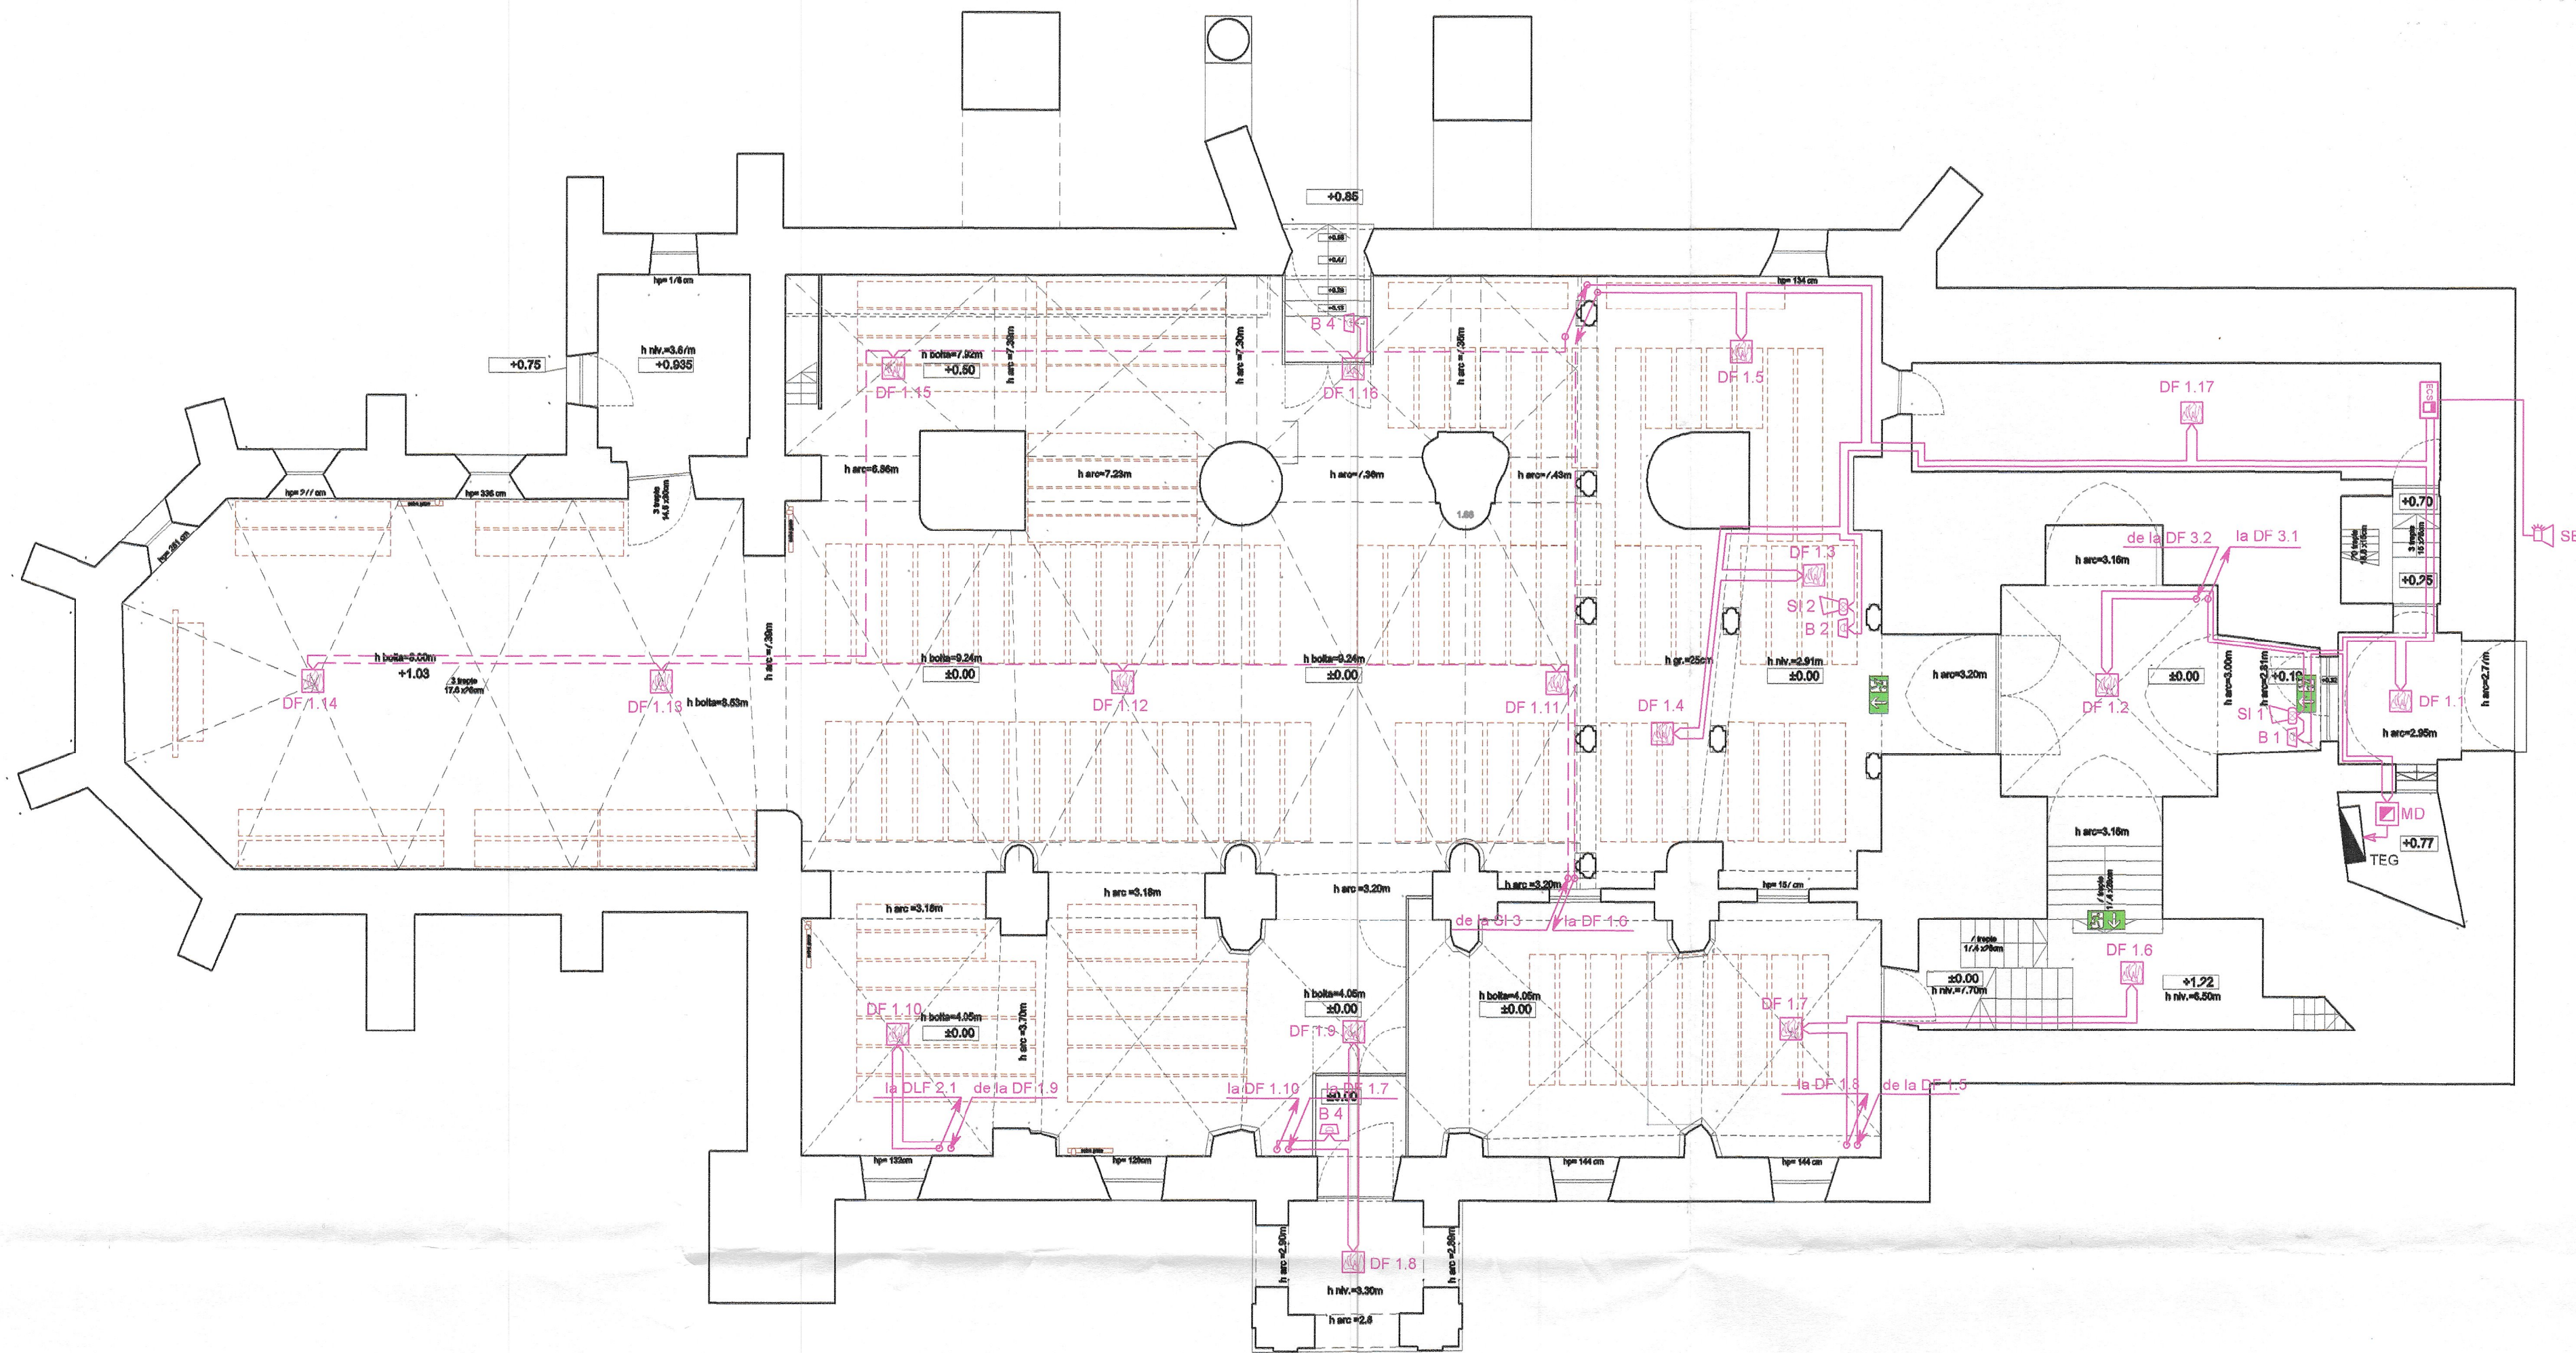

PLAN COTA + 5.00m

NOTA:
 Circuitul de detectare, semnalizare si avertizare in caz de incendiu va fi format din cabluri, cu conductoare de cupru tip JY(SI)Y sau similar 1x2x1.5 mmp, ecranate cu folie de aluminiu plus fir de legatura la masa, fara halogen (nu degaja fum la ardere), izolatie rezistenta la foc 30 min. (E30), culoare rosie sau portocalie.
 Cablurile aferente instalatiei de detectare, semnalizare si avertizare in caz de incendiu vor poza la cel putin 30cm de cablurile de energie.

- LEGENDA**
- circuit instalatie de detectare, semnalizare si avertizare in caz de incendiu montat ingropat in zidarie
 - circuit instalatie de detectare, semnalizare si avertizare in caz de incendiu montat aparent deasupra planseului
 - detector de fum adresabil
 - declansator manual de alarmare (buton de semnalizare manuala) adresabil
 - dispozitiv de alarmare de interior cu semnalizare optica, adresabil
 - dispozitiv de alarmare de exterior
 - detector liniar de fum
 - prisma reflectorizanta

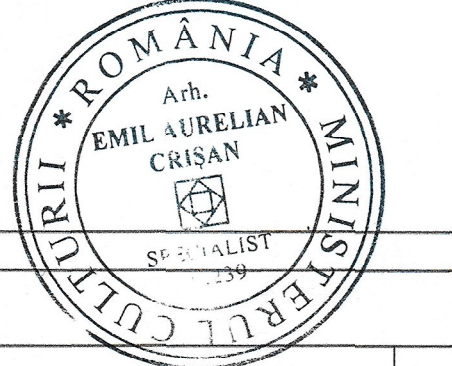

VERIFICATOR/ EXPERT	NUME	SEMNA TURA	CERINTA	Beneficiar:	Proiect nr.:
	PALAINA A.L. - INTREPRINDEREA PALAINA A.L. SIBIU, str. CALEA GUSTERITELI nr. 65 C.U.I. 24629020; F32/113/2004 aut. CNSIPC seria A 1643/2011			PAROHIA EVANGHELICA C.A. AGNITA	5/2018
SPECIFICATIE	NUME	SEMNA TURA	SCARA:	Titlu proiect:	Faza:
Sef proiect	ing. E.A. Crisan		1:100	RESTAURAREA ANSAMBLULUI BISERICII EVANGHELICE FORTIFICATE AGNITA	P.Th.
Proiectat	ing. S. Palaina		DATA:	Titlu plansa:	Plansa nr.:
			04.2018	INSTALATII DE DETECTARE, SEMNALIZARE SI AVERTIZARE LA INCENDIU	1/1